

Evidence of performance
Airborne sound insulation of building components

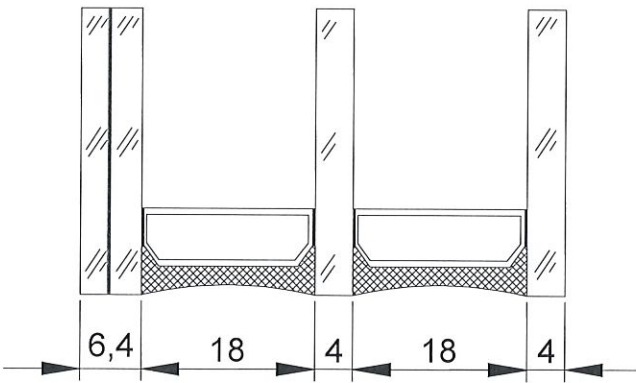
Test Report

No. GLA-1295.5/16

Client**Pilkington IGP Sp. z o.o.**

ul. Portowa 24

27-600 Sandomierz

Product:	Insulating glass unit
Construction:	33.1 / 18 / 4 / 18 / 4
Designation:	Optilam 6,4 mm 33.1 / 18 Ar / 4 mm Optifloat / 18 Ar / Optifloat 4 mm
Dimension:	1230 mm x 1480 mm
Gas filing:	Argon
Area related mass	38 kg/m ²
Cross-section:	
Rating	Weighted sound reduction index R_w and the spectrum adaptation terms: C and C_{tr}
Basis	EN ISO 10140-1:2010 EN ISO 10140-2:2010 EN ISO 717-1: 2013
Value	$R_w (C; C_{tr}) = 37 (-3; -7) \text{ dB}$

Łozienica, 29.12.2016

**PhD Krzysztof Mech**
Head of Acoustics Laboratory